
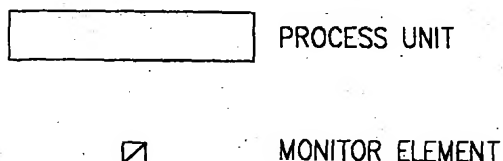
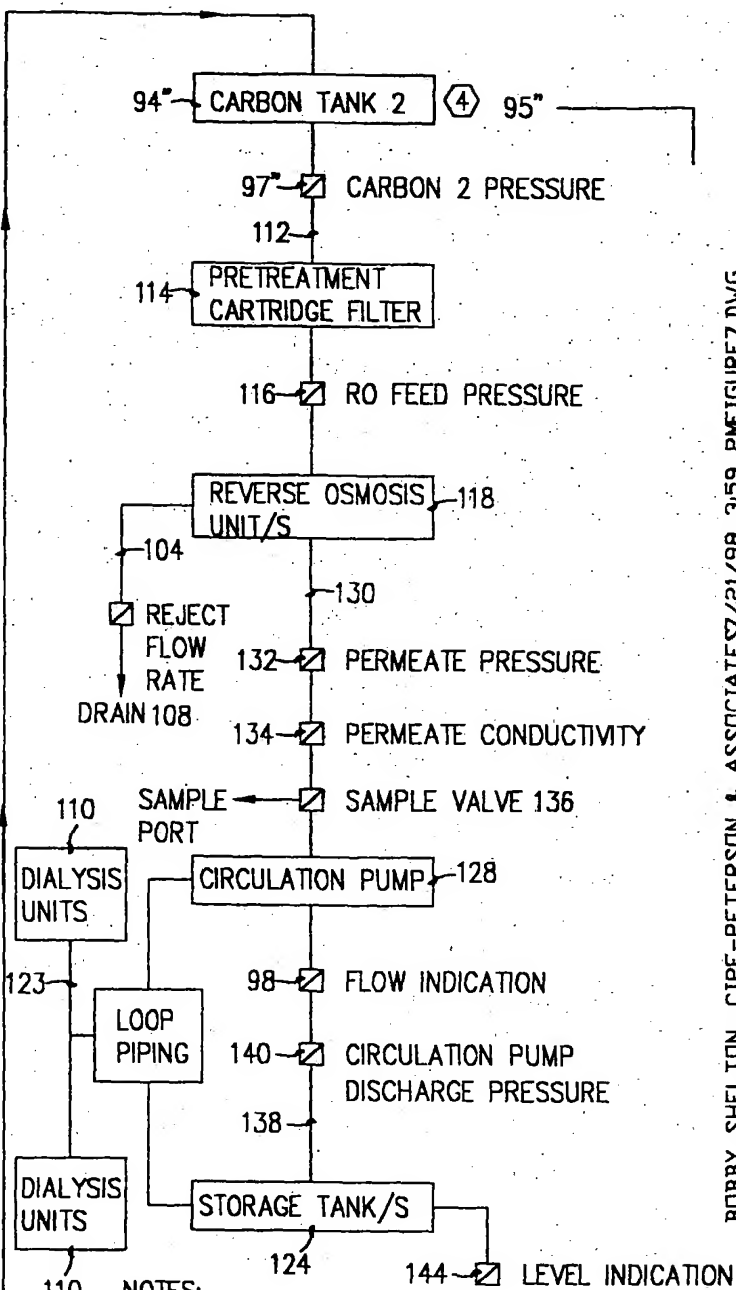


# ISOMETRIC VIEW


FIG. 1

BLC FLOW DIAGRAM FOR WATER TREATMENT SYSTEM

FIG. 2

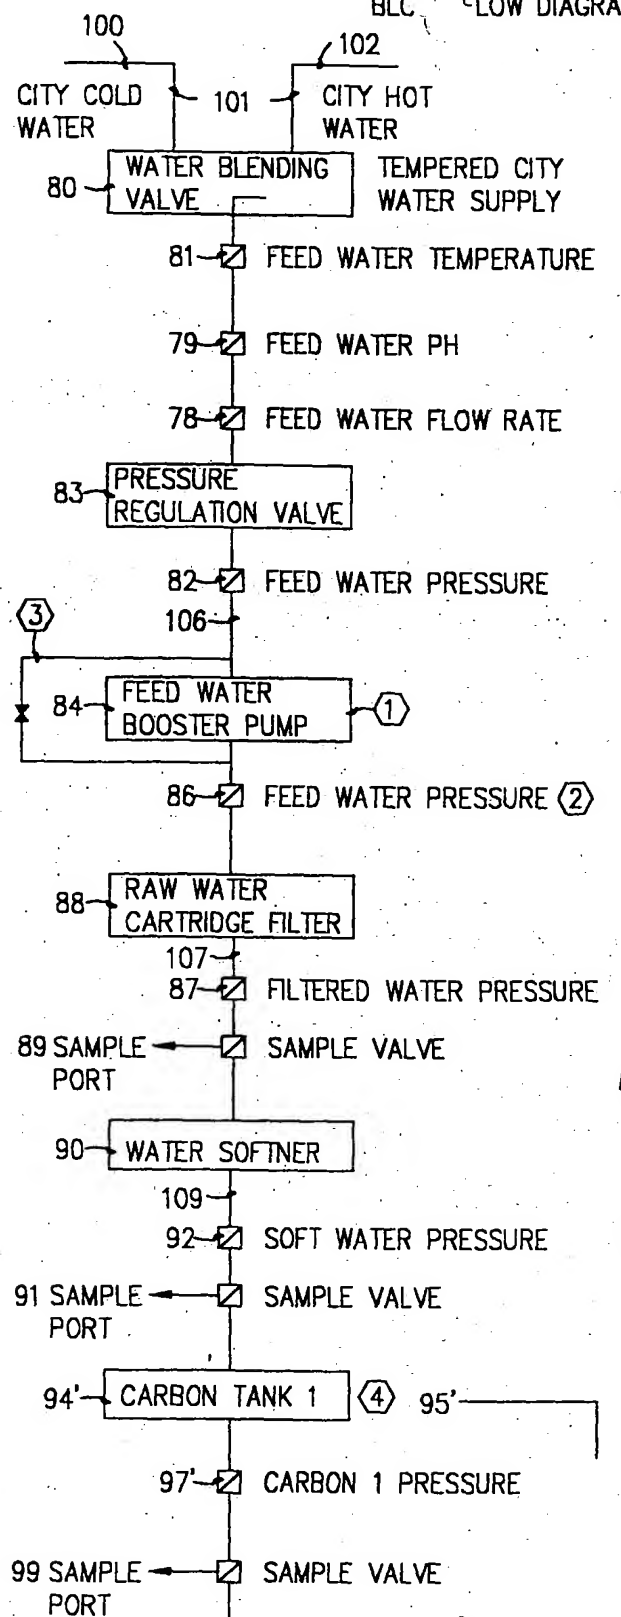

- NOTES:
- ① OPTIONAL DEPENDING ON CITY WATER PRESSURE.
  - ② OPTIONAL, INCORPORATED IF BOOSTER PUMP USED.
  - ③ PUMP BYPASS (OPTIONAL).
  - ④ OPTION TO BACKWASH CARBON TANK. BACKWASH TO DRAIN, 104.

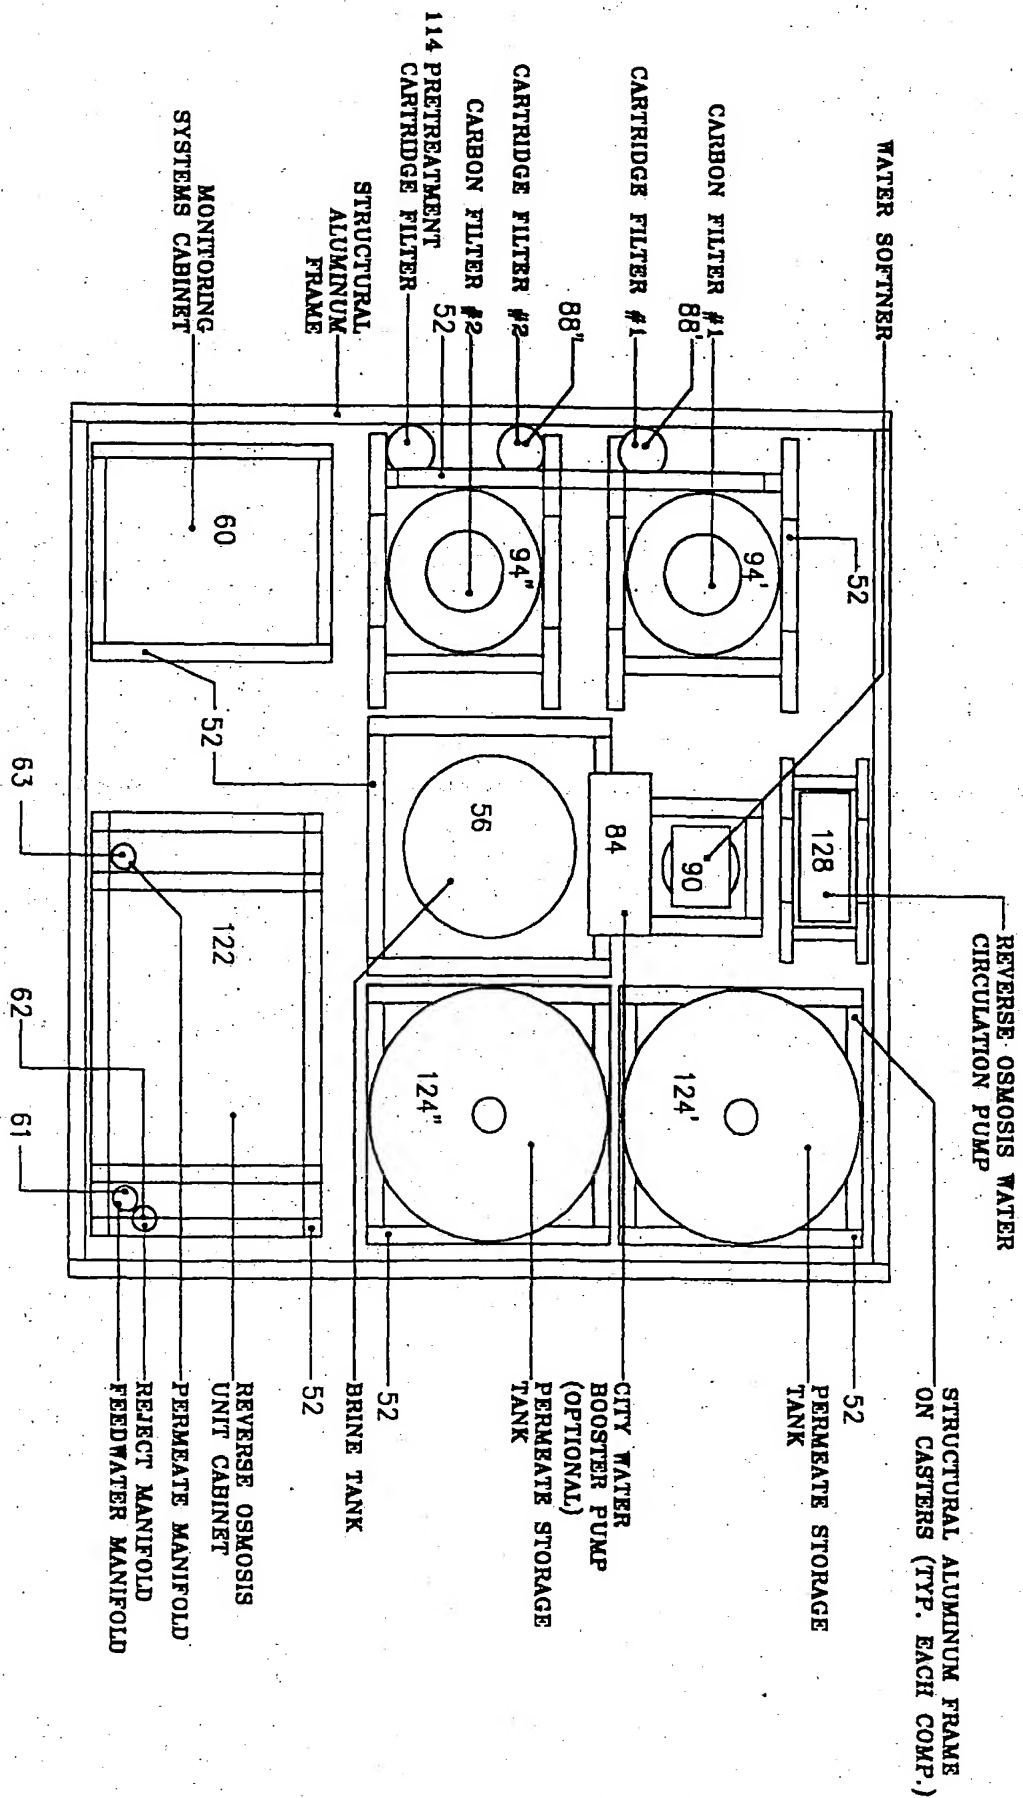


TOP VIEW

FIG. 3


NTS

10

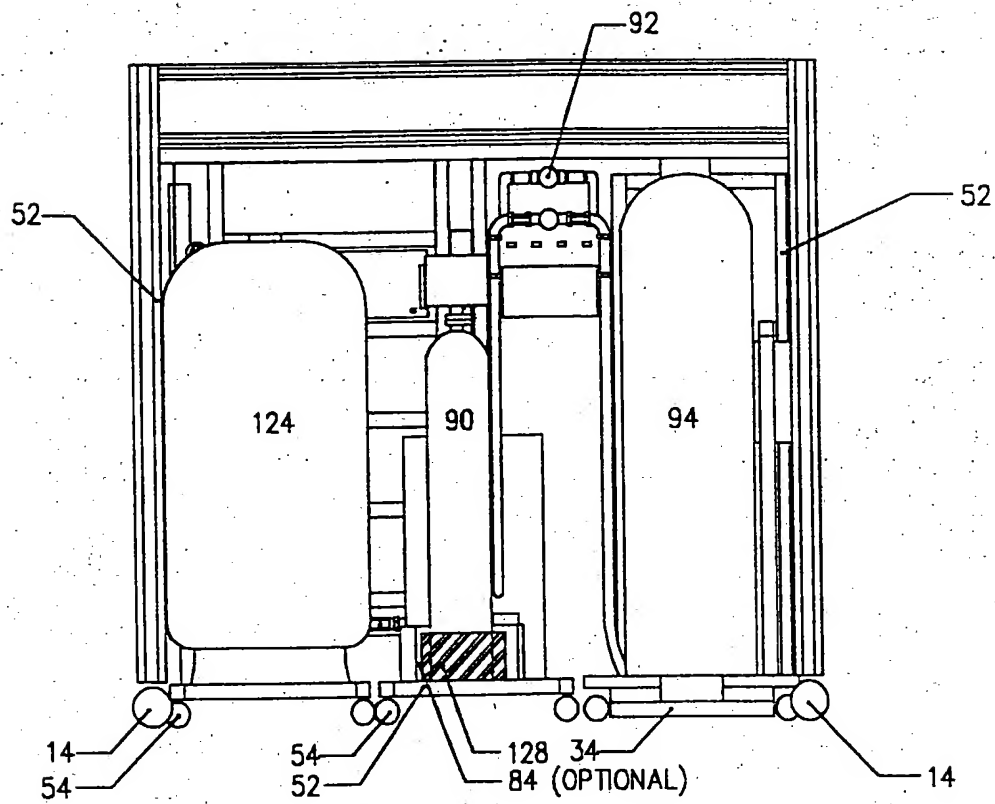


**REAR VIEW**  
NTS

FIG. 4

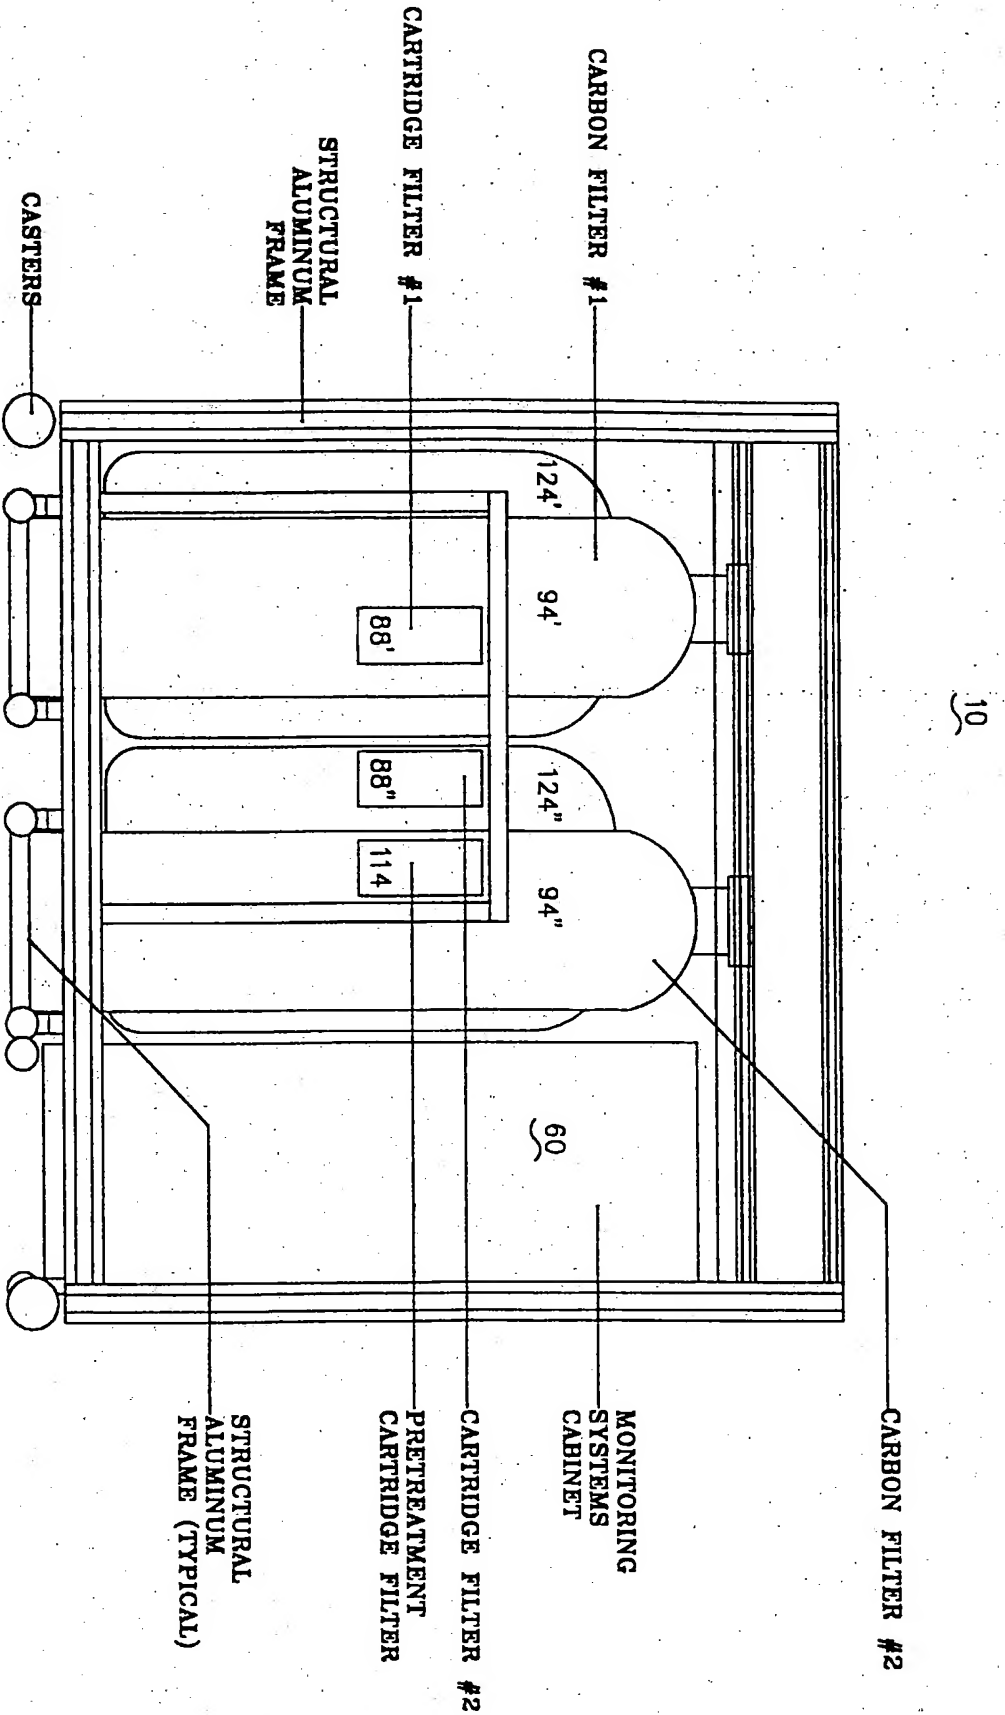


LEFT VIEW

FIG. 5

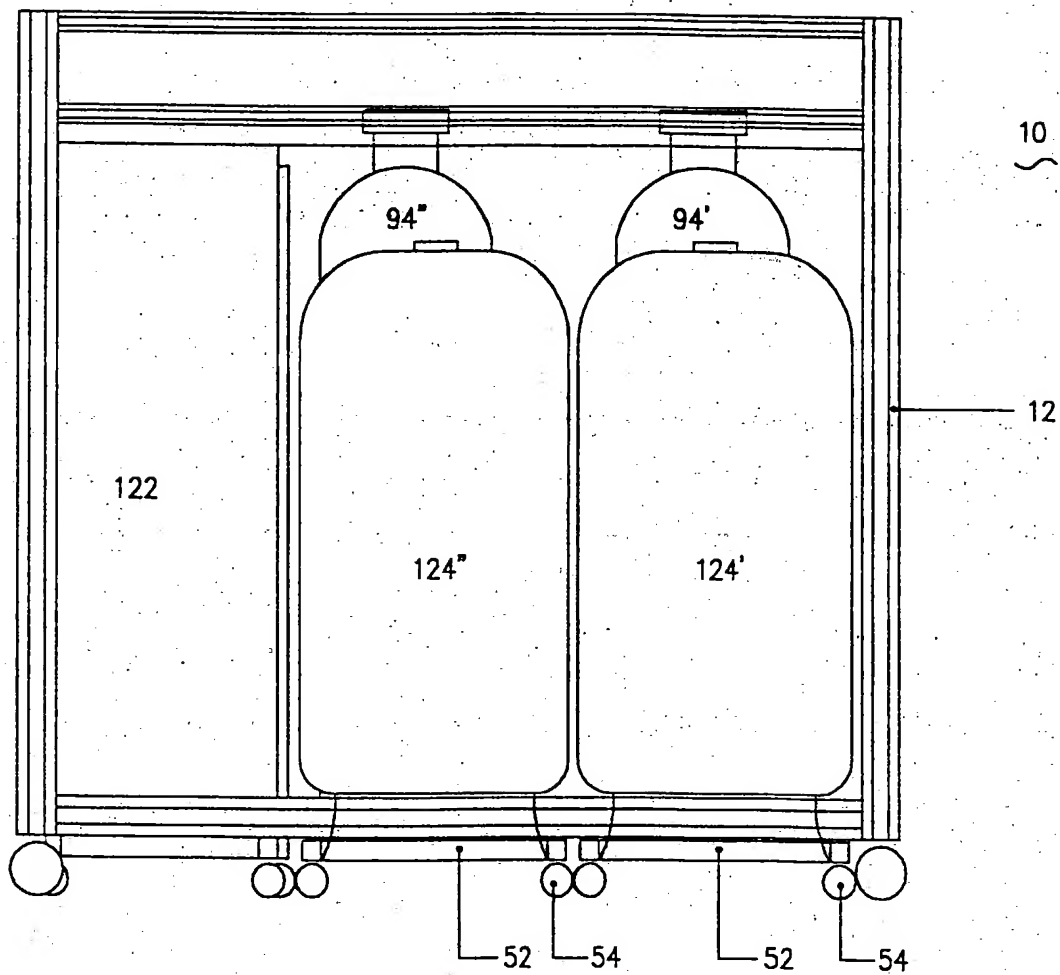

RIGHT VIEW

FIG. 6

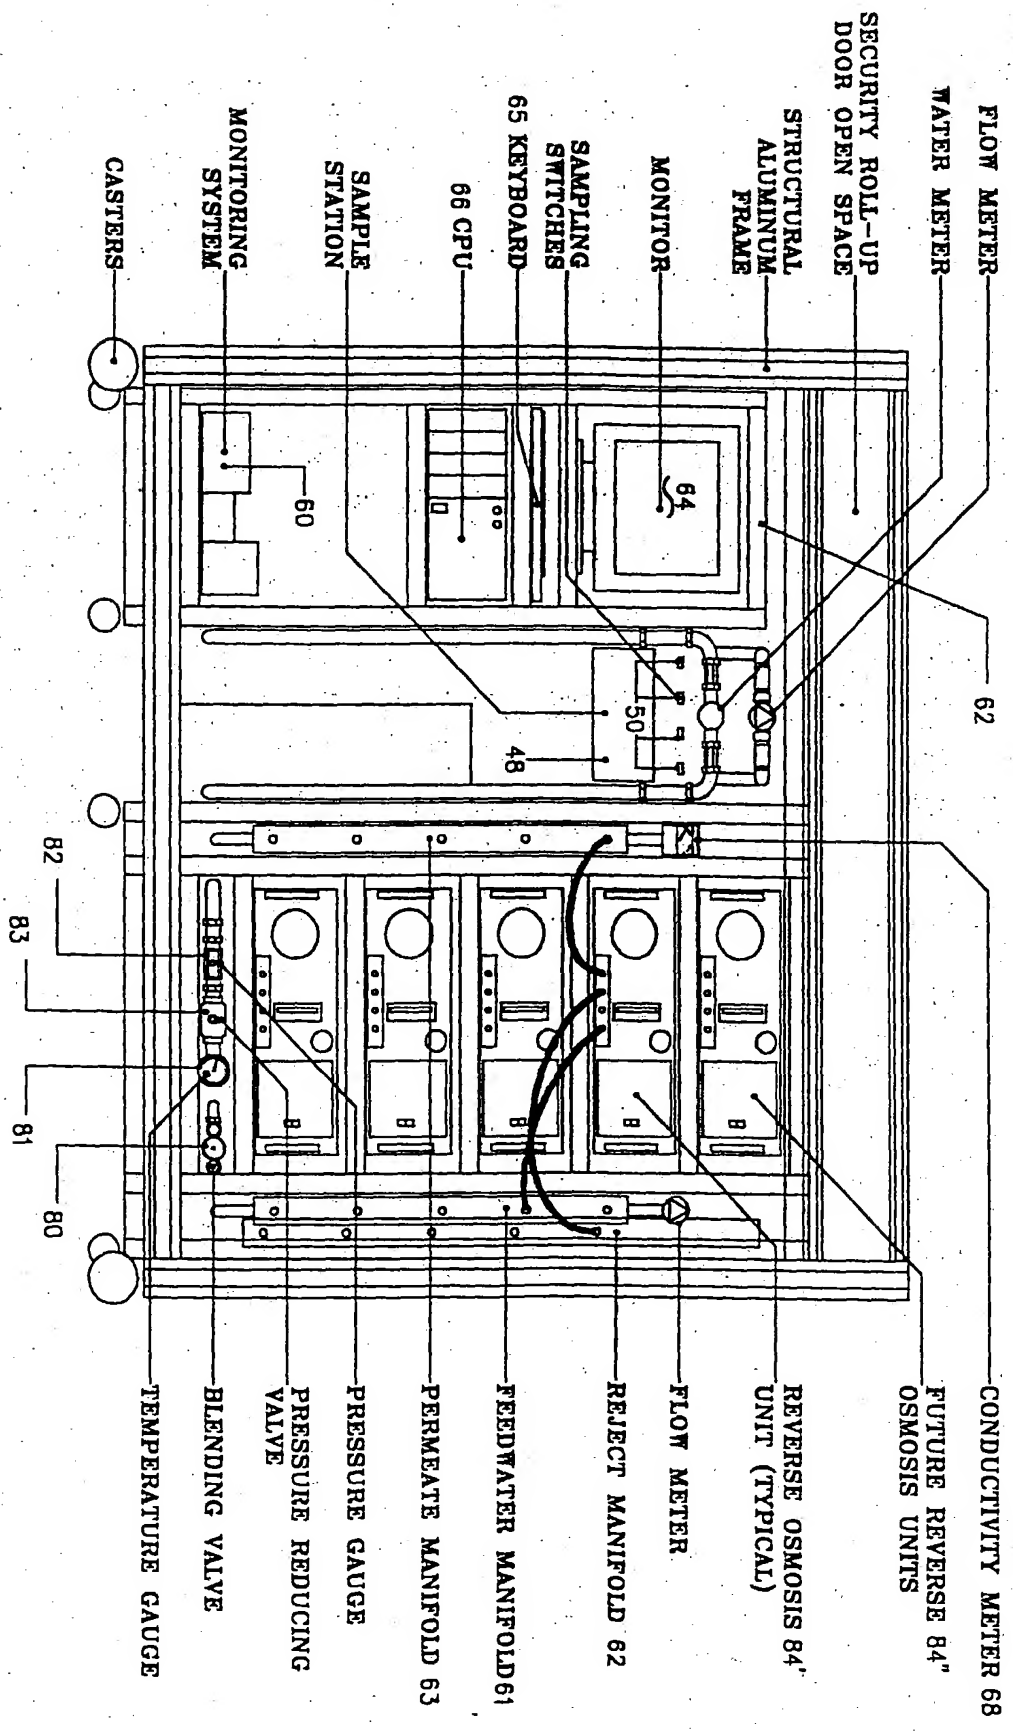

FRONT VIEW

FIG. 7